


# Actuator datasheet

## GSV180XF07F10

Modification reserved. Rev.date 05.2021.  
No guarantee for accuracy.  
Older data sheets are invalid

COMPANY WITH  
MANAGEMENT SYSTEM  
CERTIFIED BY DNV GL

= ISO 9001 =  
= ISO 14001 =

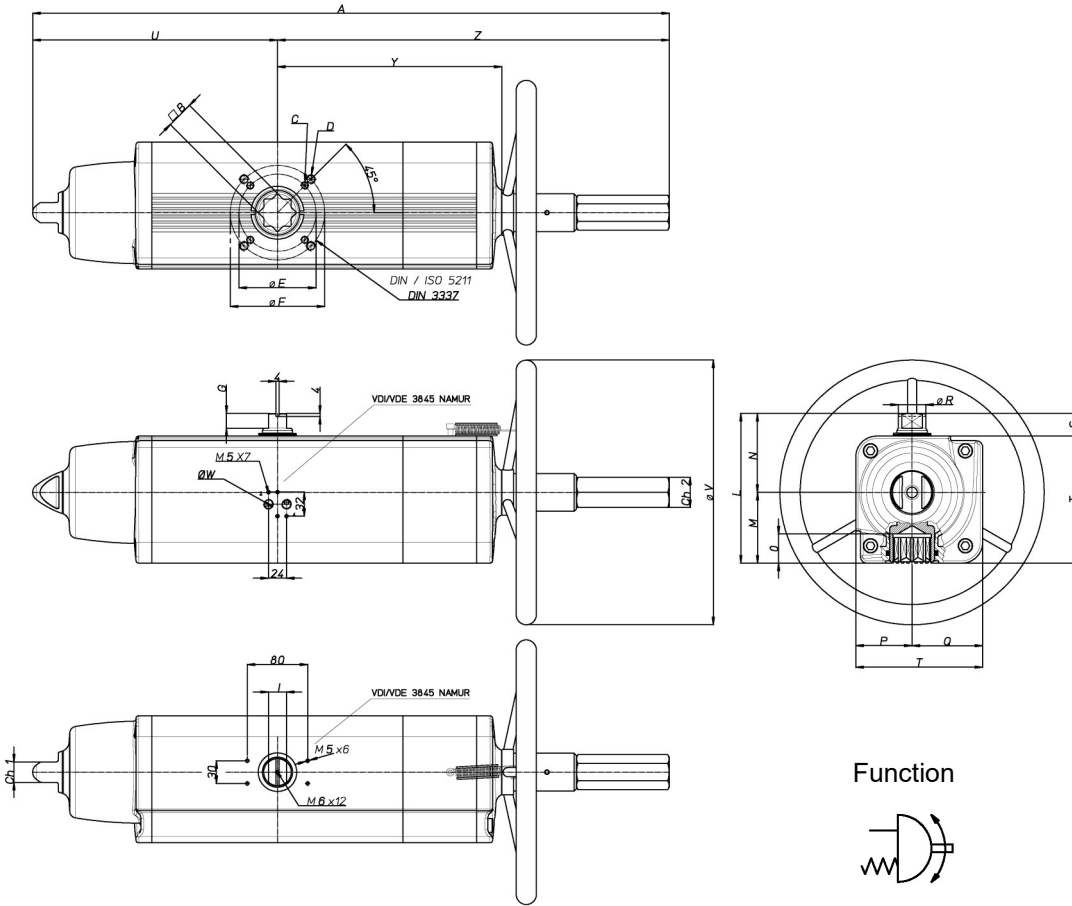

Ref.	Dimensions (mm)
Flange	F07 – F10
C x depth	M8x12
D x depth	M10x15
E	70
F	102
B	22
O	24,3
A	635,3
G	19
I	19
L	148
M	62
N	86
P	56
Q	62
R	25,5
S	30
T	118
U	237
V	300
Y	220,8
w	1/8" GAS
Z	398,4
Ch 1	22
Ch 2	40
Ancillaries Attachment	AA2

### Spring return Actuators Normally Closed (N.C.) - Output Torque related to rotation angle, in Nm (0° valve closed 90° valve open)

Spring Torque	Air pressure supply in bar																																	
	2,4						2,8			3			3,5			4,2			5			5,6			6			7			8			
	SIZE	0°	50°	90°	0°	50°	90°	0°	50°	90°	0°	50°	90°	0°	50°	90°	0°	50°	90°	0°	50°	90°	0°	50°	90°	0°	50°	90°	0°	50°	90°			
2,8	60,0	45,0	90,0	68,6	32,1	38,6	90,0	45,0	60,0	100,7	51,4	70,7	127,5	67,5	97,5	165,0	90,0	135,0																
3,5	75,0	56,3	112,5							85,7	40,2	48,2	112,5	56,3	75,0	150,0	78,8	112,5	192,9	104,5	155,4	225,0	123,8	187,5										
4,2	90,0	67,5	135,0										97,5	45,0	52,5	135,0	67,5	90,0	177,9	93,2	132,9	210,0	112,5	165,0	231,4	125,4	186,4	285,0	157,5	240,0	338,6	189,6	293,6	
5,6	120,0	90,0	180,0																147,9	70,7	87,9	180,0	90,0	120,0	201,4	102,9	141,4	255,0	135,0	195,0	308,6	167,1	248,6	

### Technical Data

Max Pressure	** Min Pressure	Rotation	Stroke Adjustment	Screw Stroke Adjustment	*Moving time (sec.)		Operating temperature (°C)
					Opening	Closing	
8.4 bar	1 bar	92° -1° +91°	Not available	-	1.29	1.41	Standard -20°C +80°C High temperature -20°C +150°C Low temperature -50°C +60°C

Weight Kg	Chamber Ø (mm)	Air volume L/cycle	Theoretical n° of turns to close/open starting from neutral position	Rim pull force (N) to obtain the nominal torque	Maximum flange torque values
11.7	90	1.01	15	67.5	F07 = 250 Nm F10 = 500 Nm

**\*\*Attention:**  
for "High Temperature" and "Low Temperature" version, the Min Pressure is 3 bar.

\*The moving time could vary on different operating and installation factors .

#### Operating Medium

The operating medium shall have a dew point equal to - 20 °C or, to be at least, 10 °C below the ambient temperature (ISO 8573-1, Class 3).  
The maximum particle size shall not exceed 40 µm (ISO 8573-1, Class 5).